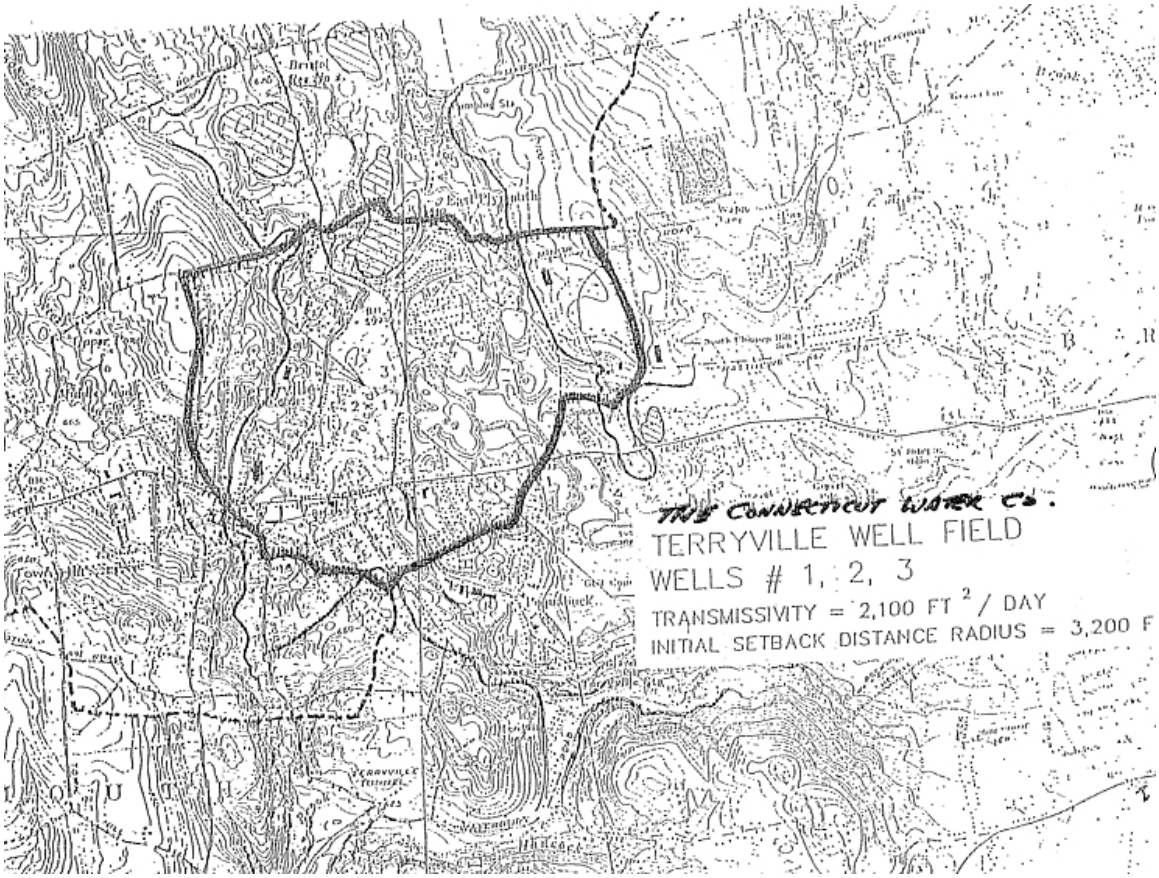
THE CONNECTICUT WATER CO.
TERRYVILLE WELL FIELD
WELLS # 1, 2, 3
TRANSMISSIVITY = 2,100 FT 2 / DAY
INITIAL SETBACK DISTANCE RADIUS = 3,200 F